

FIRE SEALS

LP1004, LP1504, LP2004


Our intumescent fire door seals offer fire protection where no smoke sealing is required. Combine a fire seal with a Batwing® seal for acoustic + smoke containment. Available in a choice of sizes to cover 30 + 60 minute applications.




LP1004 Fire seal




LP1504 Fire seal



LP2004 Fire seal

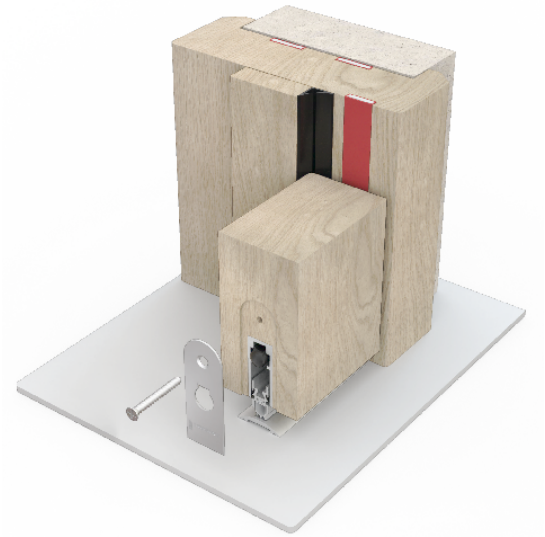

FD30 example:
Fire seal (Shown with Batwing® & LAS8001 si)

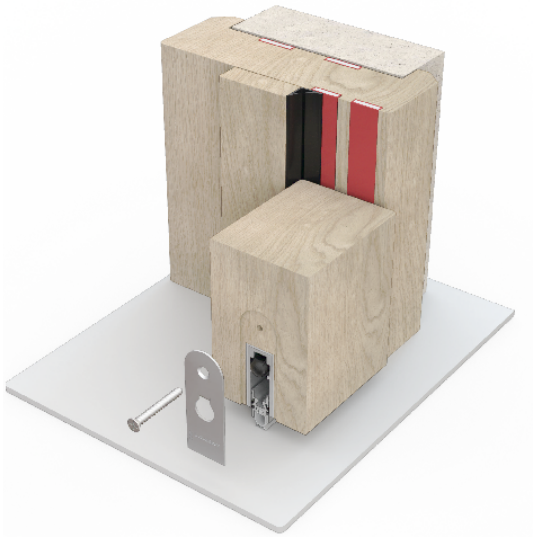

FD60 example:
Fire seal (Shown with Batwing® & LAS8001 si + cladding kit)

Note: It's essential to consult the manufacturer to determine exactly what configuration of seal & size of seal have been tested.

SYSTEM SPECIFICATIONS

Test evidence
- Fire: BS 476-22:1987 & BS EN 1634-1:2008.
- Assessment: CNA/F14171.

Characteristics
- Protects against fire.

Location
- Single and double leaf doors.

Size
- 10 x 4mm, 15 x 4mm, 20 x 4mm.
- Other sizes available, please ask for details.

Min/max gap size
- 3mm/4mm

Use with
- Any architectural seals.

Seal material
- PVC encased sodium silicate.

Standard lengths
- 1m and 2.1m.
- Other lengths to special order.

Fixing
- Heavy duty self-adhesive backing tape.

Finishes
- Black, white, dark brown, light brown and grey as standard.
- Cream, red, silver & woodgrains are subject to MOQs.

Certification

BBA BRITISH BOARD OF AGRÉMENT CERTIFICATE No. 92/2841

certifire
(CF330 & CF341)

IFC Certification

NBS Source PARTNER

T: +44 (0)1626 834252
E: mktg@lorientuk.com

LORIENT
ASSA ABLOY